

## Overview

Storm-time geomagnetic disturbances induce significant geoelectric fields within the Earth that can adversely affect the operation of electric power grids.



<http://www.spaceweather.gc.ca>




<http://www.spaceweather.gc.ca>

We present a data-driven hazard analysis of voltages that are estimated to happen on-average once-per-century.


## Identifying Storms

Storms are selected through an iterative process. The minimum Dst in the dataset is selected, and then 1.5 days on each side of this minimum is specified as a storm-time. This is repeated until there are no Dst values less than -140 nT. This process identifies 78 storms from 1985-2015.

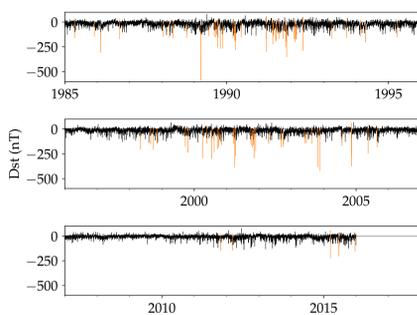

## Individual Storm Calculations


For each geomagnetic storm identified above, we gather all of the recorded time-series of magnetic observatory measurements from the USGS and NRCAN.

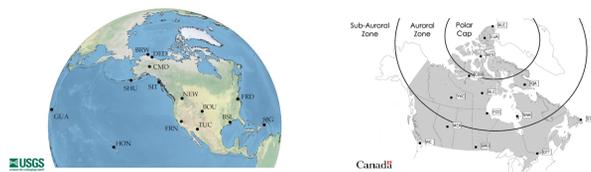

## Magnetic Field

We then interpolate these magnetic measurements with SECS basis functions across the US to generate estimated magnetic field time-series at each magnetotelluric (MT) site from the NSF EarthScope Project.

$$\bar{B}_{site} = f(\bar{B}_{obs1}, \bar{B}_{obs2}, \dots)$$

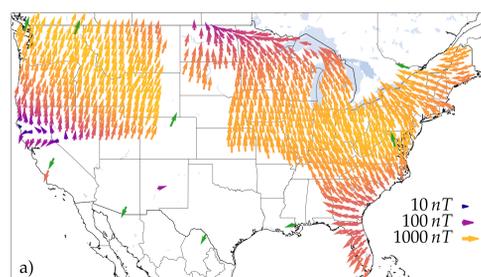


01:00 UTC on March 14, 1989

## Electric Field

An electric field time series is produced at each site through a convolution of the local site impedance (related to Earth conductivity structure) with the local magnetic field.

Impedance tensors are obtained from the NSF EarthScope Project: <http://ds.iris.edu/spud/emtf>

$$\bar{E}_{site} = \bar{Z}_{site} * \bar{B}_{site}$$

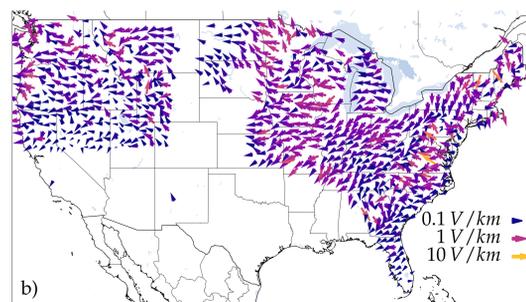


01:00 UTC on March 14, 1989

## Transmission Line Voltages

The voltage induced in the transmission lines is calculated by integrating the electric fields along the transmission lines

$$V = \int_L \bar{E} \cdot d\bar{l}$$

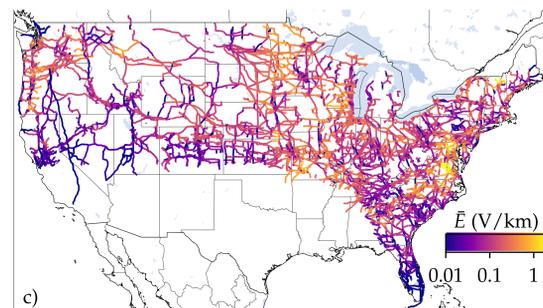


01:00 UTC on March 14, 1989

Plotted is  $\bar{E} = V/L$ , to scale the voltages, which produces a better visualization to account for the large disparity in line lengths throughout the US

## Statistical Analysis


For each storm, the peak amplitude of each quantity is identified at all MT sites. This produces a list of storm maximums at each site that can be viewed as a cumulative distribution. We then fit a lognormal curve to the cumulative from each site to predict the maximum that would be expected on-average once-per-century.

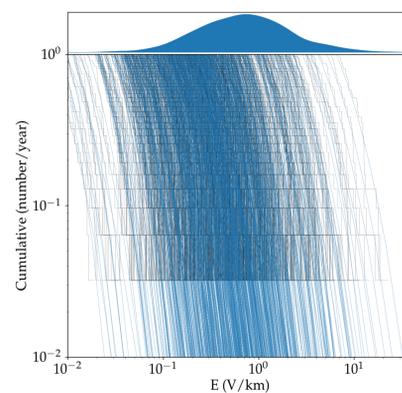

## Hazard Analysis

The once-per-century amplitudes viewed across the US, enables stake-holders to identify areas that are more or less prone to geomagnetic storm effects

### 100-year Amplitudes

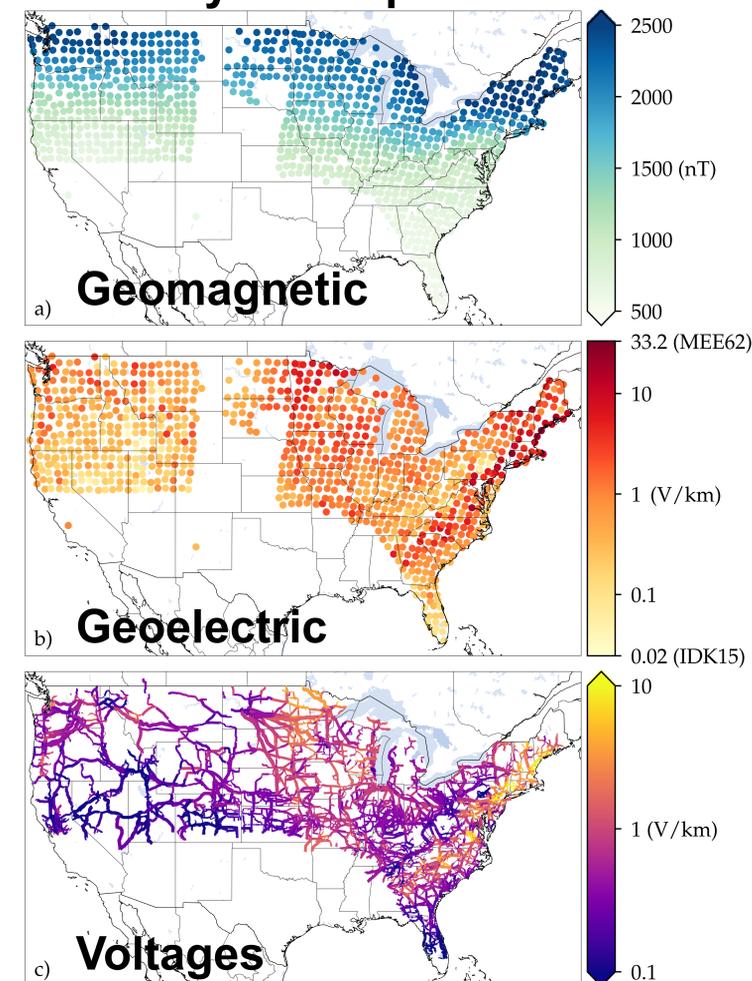

- The magnetic field amplitudes vary by about one order of magnitude, aligned primarily with the N-S geomagnetic poles.
- The geoelectric hazard spans more than 3 orders of magnitude and is strongly driven by geologic features, although the magnetic trend is still in the data.
- Large voltages in transmission lines correspond to regions of high geoelectric hazard while also incorporating directionality of the lines into the equation.

## Summary

A data-driven statistical approach was used to calculate once-per-century geomagnetic, geoelectric, and transmission line hazards across the US. This data can be used to update benchmarks and standards within the Space Weather and Electric Utility communities.

Get in touch: Greg Lucas, [glucas@usgs.gov](mailto:glucas@usgs.gov)  
All of the data and code are available under open-source licenses for everyone to use. I'm always looking for other collaborations, so please reach out if this interests you!